

WS-1

TOWN OF AURORA

300 GLEED AVENUE, EAST AURORA, NY 14052

BUILDING DEPARTMENT

(716) 652-7591

FAX (716) 652-3507

MEMO

TO: Jim Bach & Town Board Members
FROM: Don Owens, Chairman, Planning Board
DATE: October 5, 2017

=====

Douglas Crow moved to recommend the Town Board approve the Site Plan as proposed for 180 Ellicott Rd, Town of Aurora subject to additional details of the swale design as requested by the Town Engineer.

Seconded by Laurie Kutina.

Upon a vote being taken:

ayes – six

noes – none

Motion Carried.

Douglas Crow moved to recommend the Town Board approve the Special Use Permit as proposed for an office and warehouse for Mr. Daniel Orfeo at 180 Ellicott Rd, Town of Aurora.

Seconded by Norm Merriman.

Upon a vote being taken:

ayes – six

noes – none

Motion Carried.

SUPERVISOR
James J. Bach
(716) 652-7590
jbach@townofaurora.com



WS-3 ERK
prock
3280
TOWN OF AURORA .com

TOWN OF AURORA
Southside Municipal Center
300 Glead Avenue, East Aurora, NY 14052
www.townofaurora.com

TOWN COUNCIL MEMBERS

October 4, 2017

Susan A. Friess
sfriess@townofaurora.com

Jeffrey T. Harris
jharris@townofaurora.com

Jolene M. Jeffe
jjeffe@townofaurora.com

Charles D. Snyder
csnyder@townofaurora.com

SUPT. OF HIGHWAYS
David M. Gunner
(716) 652-4050
highway@townofaurora.com

SUPT. OF BUILDING
Patrick J. Blizniak
(716) 652-7591
building@townofaurora.com

ASSESSOR
Richard L. Dean
assessor@townofaurora.com
(716) 652-0011

DIR. OF RECREATION
Peggy M. Cooke
(716) 652-8866
peggy@townofaurora.com

TOWN ATTORNEY
Ronald P. Bennett

TOWN JUSTICE
Douglas W. Marky
Jeffrey P. Markello

HISTORIAN
Robert L. Goller
(716) 652-7944
historian@townofaurora.com

FAX: (716) 652-3507

To: Town Board Members

I respectfully request the Town Board approve of the purchase of up to 5 Mueller Hydro-guard water sample stations. The sample stations are a patented product of Mueller Inc. There is no other manufacturer that has the same features that allow for sever winter climate sampling without an evacuation pump. Due to this I am unable to get 3 quotes. I have received the following quote from the authorized Mueller dealer Lock city:

\$1584.00 includes freight per unit.


It is my intention to buy a minimum of 2 for Mitchell Drive and Hickory Drive. If there is enough left in the water improvement bond I would like to install the other 3 at Westgate Drive, South Herrick Drive, and Mary Janes Lane.

These sample stations will allow access to the waterlines 24 hours a day year round to perform mandatory water testing.

Sincerely,

A handwritten signature in black ink, appearing to read "D. Gunner".

David M. Gunner
Superintendent of Highways



LOCK CITY SUPPLY INC.

650 WEST AVENUE
 P.O. BOX 481
 LOCKPORT, NY 14095

PRICE QUOTE

Phone 716-625-8666
 Fax 716-434-0296

Page 1

Printed 09/29/17 SL

Quoted

AURORA TOWN OF
 251 QUAKER ROAD
 EAST AURORA NY 14052
 Tel: Fax: 716-652-1123

Ship To

SAME

| | | | | | | |
|----------------|----------------|------------|------------|----------------|----------|--------|
| Quote # | Quote Date | Exp. Date | Customer # | Customer P/O # | Ship Via | Writer |
| 030586 | 09/29/2017 | 10/29/2017 | 0002140 | | | SL |
| Job ID | Customer Terms | | | Salesman | | |
| HYDROGUARD BSS | Net 30 Days | | | SCOTT LITTLE | | |

| Product | Description | UM | Quant | Unit Price | Disc% | Extension |
|---------|---|----|-------|------------|-------|-----------|
| SP | HYDROGUARD BSS SAMPLING STATION. 5'0 BURY, METAL ENCLOSURE, GREEN. #BSS0160MUDG1CSDNL00 ***** ***** FREIGHT IS ADDITIONAL APPROXIMATELY \$250.00 | EA | 2 | 1459.0000 | NET | 2918.00 |

| | | |
|---------------------------|------------|------------|
| X: _____ (Accepted by) | Sub Total | \$2,918.00 |
| | Tax Amount | \$0.00 |
| | Total | \$2,918.00 |

MESSAGE

TERMS + 250.00 FREIGHT

\$ 3168.00



Safety-Guard⁺

B.O.S.S.


Blow-Off Sampling Stations
Dedicated Sampling Point • Secure and Easy to Install

While there are many methods for taking samples of potable water, there's only one that provides all the important advantages of the Safety-Guard® Sampling Station from Hydro-Guard® by Mueller Co.

- Self-locking, UV-protected plastic or powder-coated steel enclosure
- Self-supporting powder-coated steel frame needs no additional base or supports
- 360° accessibility for greater location serviceability
- OEM-installed breakaway feature, yet impact resistant
- Optional thermal control valve for freeze protection
- Optional internal curb stop valve, with or without a drain

Using a dedicated, permanent sampling point is by far the most reliable method for taking a water sample. It also avoids possible contamination of the sample that could come from using hose bibs or a customer's faucet. In addition, using a dedicated sampling station that the utility owns and controls avoids having to go onto private property which could put crews in danger and the utility at risk of costly liability.

Safety-Guard® Sampling Stations are for use in warm to moderate cold climates, with a thermal control valve option for use in regions subject to freezing temperatures. Units are available with a choice of UV-protected impact-resistant plastic or powder-coated steel enclosures that provide both security with their self-locking feature, and installation stability that needs no additional concrete pad or supporting post.

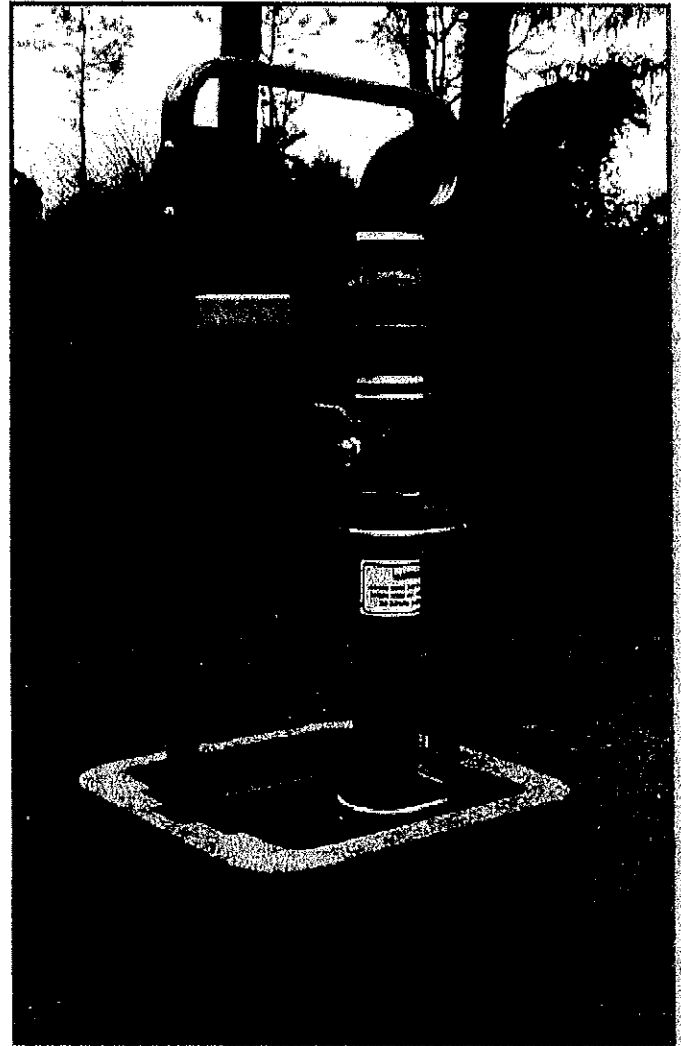

Comply with EPA Stage II DBPR Standards using reliable, well-engineered Safety-Guard® sampling stations.



Orders and Information:
(877) 864-8500
www.Hydro-Guard.com